SULLIVAN COUNTY RURAL ELECTRIC CO-OP, INC.


P.D. BOX 65, ROUTE 87 FORKSVILLE, PENNSYLVANIA 18616

(570) 924 - 3381 www.screc.com (800) 570 - 5081

email: screc@epix.net

INSTALLATION REQUIREMENTS OF CENTER LOAD POLE MOUNTED SERVICES WITH ENTRANCE CABLE-GENERATOR SWITCH

IMPORTANT:

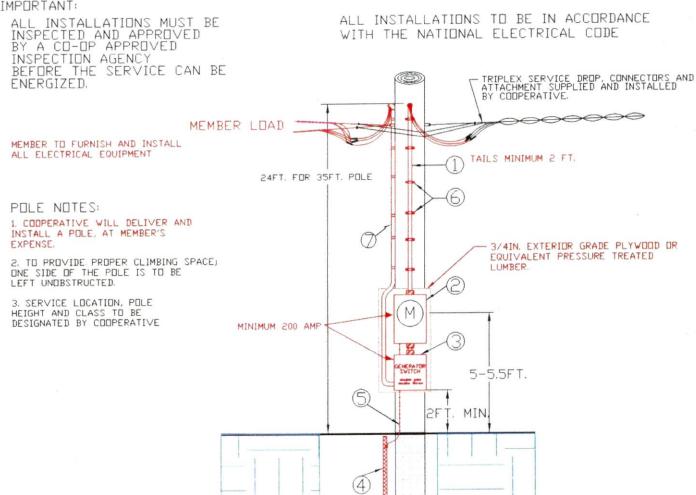

FURNISHED AND INSTALLED BY MEMBER

- SERVICE ENTRANCE CONDUCTORS WITH WEATHERHEAD 200 AMP 4/0 ALUMINUM OR 2/0 COPPER
- MEMBER DWNED 4 JAW UL APPROVED RINGLESS TYPE METERBASE WITH WEATHER TIGHT HUBS PURCHASED FROM AN ELECTRICAL SUPPLY COMPANY.
- MEMBER DWNED SERVICE EQUIPMENT UL APPROVED DUTDOOR FUSED DISCONNECT SWITCH WITH DOUBLE POLE DOUBLE THROW GENERATOR SWITCH, MUST HAVE DVER CURRENT PROTECTION
- DNE (1) 5/8 IN. × 8 FT. COPPERWELD GROUND ROD.
- GROUND WIRE # 4 BARE COPPER MINIMUM FOR A 200 AMP INSTALLATION.
 WHERE AVAILABLE, SERVICE SHOULD ALSO BE GROUNDED TO WELL CASING OR UNDERGROUND METALLIC WATER PIPING SYSTEM.ZOOM
 GAS OR FUEL DIL PIPING SHALL NOT BE USED AS A GROUNDING ELECTRODE.
- (6) PIPE STRAPS TO BE PLACED 6 TO 10 IN. FROM WEATHERHEAD AND METERBASE AND AT THREE (3) FT. INTERVALS.
- MEMBER SUPPLIED SERVICE ENTRANCE CONDUCTOR WITH WEATHERHEAD 200 AMP 4/0 ALUMINUM OR 3/0 COPPER