

SULLIVAN COUNTY RURAL ELECTRIC CO-OP, INC.


P.O. BOX 65, ROUTE 87
 FORKSVILLE, PENNSYLVANIA 18616
 (570) 924 - 3381 www.screc.com
 (800) 570 - 5081 email: screc@epix.net

INSTALLATION REQUIREMENTS FOR OVERHEAD SERVICE TO A PERMANENT BUILDING

IMPORTANT:

ALL INSTALLATIONS MUST BE INSPECTED AND APPROVED BY A CO-OP APPROVED INSPECTION AGENCY BEFORE THE SERVICE CAN BE ENERGIZED.

ALL INSTALLATIONS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE

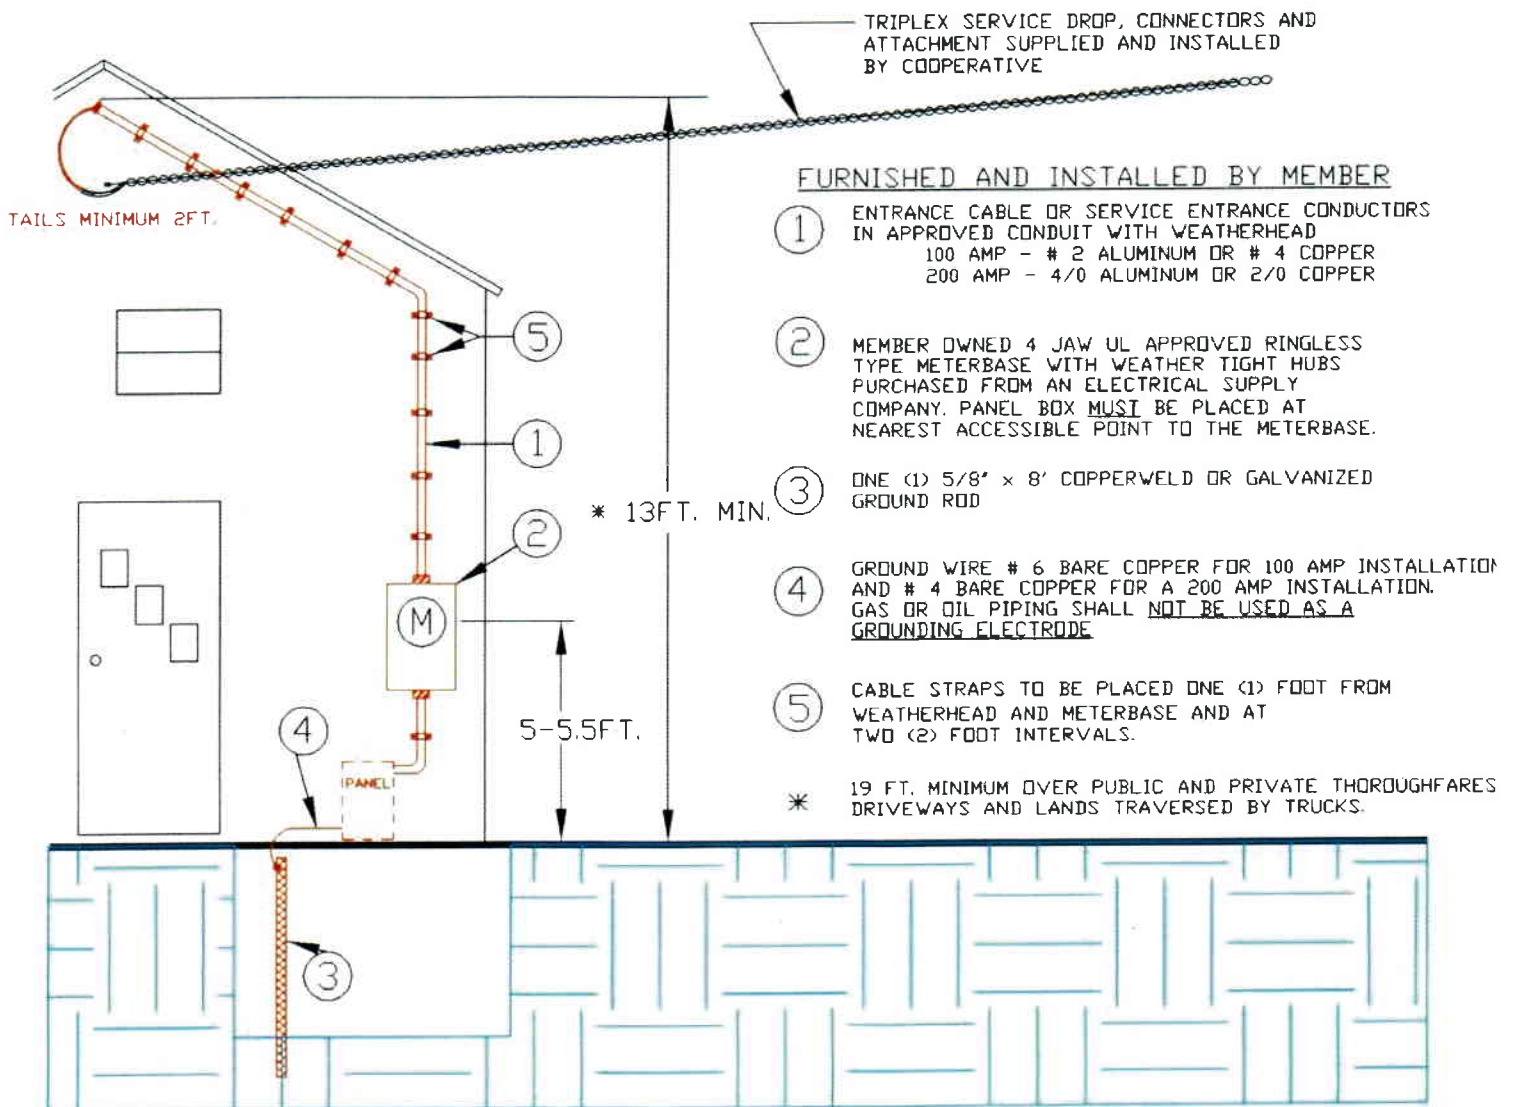

FURNISHED AND INSTALLED BY MEMBER

- ① ENTRANCE CABLE OR SERVICE ENTRANCE CONDUCTORS IN APPROVED CONDUIT WITH WEATHERHEAD
 100 AMP - # 2 ALUMINUM OR # 4 COPPER
 200 AMP - 4/0 ALUMINUM OR 2/0 COPPER
 - ② MEMBER OWNED 4 JAW UL APPROVED RINGLESS TYPE METERBASE WITH WEATHER TIGHT HUBS PURCHASED FROM AN ELECTRICAL SUPPLY COMPANY. PANEL BOX MUST BE PLACED AT NEAREST ACCESSIBLE POINT TO THE METERBASE.
 - ③ ONE (1) 5/8" x 8' COPPERWELD OR GALVANIZED GROUND ROD
 - ④ GROUND WIRE # 6 BARE COPPER FOR 100 AMP INSTALLATION AND # 4 BARE COPPER FOR A 200 AMP INSTALLATION. GAS OR OIL PIPING SHALL NOT BE USED AS A GROUNDING ELECTRODE
 - ⑤ CABLE STRAPS TO BE PLACED ONE (1) FOOT FROM WEATHERHEAD AND METERBASE AND AT TWO (2) FOOT INTERVALS.
- * 19 FT. MINIMUM OVER PUBLIC AND PRIVATE THOROUGHFARES DRIVEWAYS AND LANDS TRAVERSED BY TRUCKS.